

EMC TEST REPORT

On Behalf of

Product Name: Circuit Breaker

Trademark: nanque

Model Number: NQCM1Z, NQCM1, NQCM1B, NQCM2, NQCM2B, NQCM2Z, NQCM3, NQCM3B, NQCM3Z, NQCM4, NQCM4B, NQCM4Z

Prepared For: Wenzhou Nanque Electric Co., Ltd.

Address: Xirendang Village, Liushi Town, Yueqing City, Wenzhou City, Zhejiang Province, China

Prepared By: Shenzhen Huaxiang Testing Co., Ltd

Address: 201, Building A10, Fuhai Information Port, Fuhai Street, Bao'an District, Shenzhen City

Report No.: HUAX230808007KR

TABLE OF CONTENT

Test Report Description

1. GENERAL INFORMATION	5
1.1. Description of Device (EUT)	5
1.2. Test Standards	5
1.3. Test Summary	6
1.4. Test Methodology	7
1.5. Test Facility	7
1.6. Measurement Uncertainty	7
2. MEASURING DEVICE AND TEST EQUIPMENT	8
2.1. For Power Line Conducted Emission	8
2.2. For Radiated Emission Measurement	8
2.3. For Harmonic Current / Flicker Measurement	8
2.4. For Electrostatic Discharge Immunity Test	8
2.5. For Electrical Fast Transient /Burst Immunity Test	9
2.6. For Surge Immunity Test	9
2.7. For Injected Current Susceptibility Test	9
2.8. For Magnetic Field Immunity Test	9
2.9. For Voltage Dips and Interruptions Test	9
3. POWER LINE CONDUCTED EMISSION MEASUREMENT	10
3.1. Block Diagram of Test Setup	10
3.2. Measuring Standard	10
3.3. EUT Configuration on Measurement	10
3.4. Operating Condition of EUT	10
3.5. Test Procedure	11
3.6. Measuring Results	11
4. RADIATED EMISSION MEASUREMENT	14
4.1. Block Diagram of Test	14
4.2. Measuring Standard	14
4.3. Radiated Emission Limits	14
4.4. EUT Configuration on Test	14
4.5. Operating Condition of EUT	15
4.6. Test Procedure	15
4.7. Measuring Results	15
5. HARMONIC CURRENT EMISSION MEASUREMENT	18
5.1. Block Diagram of Test Setup	18
5.2. Measuring Standard	18
5.3. Operation Condition of EUT	18
5.4. Measuring Results	18
6. VOLTAGE FLUCTUATION AND FLICKER MEASUREMENT	19
6.1. Block Diagram of Test Setup	19
6.2. Measuring Standard	19
6.3. Operation Condition of EUT	19
6.4. Measuring Results	19
7. ELECTROSTATIC DISCHARGE IMMUNITY TEST	21
7.1. Block Diagram of Test Setup	21
7.2. Test Standard	21
7.3. Severity Levels and Performance Criterion	21
7.4. EUT Configuration	21
7.5. Operating Condition of EUT	22
7.6. Test Procedure	22

7.7. Test Results	22
8. RF FIELD STRENGTH SUSCEPTIBILITY TEST	24
8.1. Block Diagram of Test	24
8.2. Test Standard	24
8.3. Severity Levels and Performance Criterion	25
8.4. EUT Configuration on Test	25
8.5. Operating Condition of EUT	25
8.6. Test Procedure	25
8.7. Test Results	25
9. ELECTRICAL FAST TRANSIENT/BURST IMMUNITY TEST	27
9.1. Block Diagram of Test Setup	27
9.2. Test Standard	27
9.3. Severity Levels and Performance Criterion	27
9.4. EUT Configuration	27
9.5. Operating Condition of EUT	28
9.6. Test Procedure	28
9.7. Test Result	28
10. SURGE IMMUNITY TEST	30
10.1. Block Diagram of Test Setup	30
10.2. Test Standard	30
10.3. Severity Levels and Performance Criterion	30
10.4. EUT Configuration	31
10.5. Operating Condition of EUT	31
10.6. Test Procedure	31
10.7. Test Result	31
11. INJECTED CURRENTS SUSCEPTIBILITY TEST	33
11.1. Block Diagram of Test Setup	33
11.2. Test Standard	33
11.3. Severity Levels and Performance Criterion	33
11.4. EUT Configuration	33
11.5. Operating Condition of EUT	34
11.6. Test Procedure	34
11.7. Test Results	34
12. MAGNETIC FIELD SUSCEPTIBILITY TEST	36
12.1. Block Diagram of Test	36
12.2. Test Standard	36
12.3. Severity Levels and Performance Criterion	36
12.4. EUT Configuration on Test	37
12.5. Test Procedure	37
12.6. Test Results	37
13. VOLTAGE DIPS AND INTERRUPTIONS TEST	39
13.1. Block Diagram of Test Setup	39
13.2. Test Standard	39
13.3. Severity Levels and Performance Criterion	39
13.4. EUT Configuration	39
13.5. Operating Condition of EUT	40
13.6. Test Procedure	40
13.7. Test Result	40
APPENDIX I (Photos of EUT)	

TEST REPORT DECLARATION

Applicant	:	Wenzhou Nanque Electric Co., Ltd.
Address :	:	Xirendang Village, Liushi Town, Yueqing City, Wenzhou City, Zhejiang Province, China
Manufacturer:	:	Wenzhou Nanque Electric Co., Ltd.
Address :	:	Xirendang Village, Liushi Town, Yueqing City, Wenzhou City, Zhejiang Province, China
EUT Description :	:	Circuit Breaker
Model Number	:	NQCM1Z
Rating(s)	:	DC 12-1500V, 1-630A
Test Date		Aug. 07, 2023 - Aug. 14, 2023
Date of Report		Aug. 14, 2023

Test Standards:

EN IEC 61000-6-3: 2021
EN IEC 61000-6-1: 2019
EN IEC 61000-3-2: 2019+A1:2021
EN 61000-3-3: 2013+A2:2021

The EUT described above is tested by Huaxiang Testing Co., Ltd. EMC Laboratory to determine the maximum emissions from the EUT and ensure the EUT to be compliance with the immunity requirements of the EUT. Shenzhen Huaxiang Testing Co., Ltd. is assumed full responsibility for the accuracy of the test results. Also, this report shows that the EUT technically complies with the 2014/30/EU directive and its amendment requirements.


The test report is valid for above tested sample only and shall not be reproduced in part without written approval of the laboratory.

Prepared by (Test Engineer):

Joan Wang

Approved (Manager)

Amy Jiang

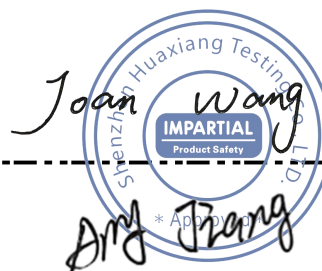

1. GENERAL INFORMATION

1.1. Description of Device (EUT)

EUT : Circuit Breaker

Model : NQCM1Z

Supplementary Model : NQCM1, NQCM1B, NQCM2, NQCM2B, NQCM2Z, NQCM3, NQCM3B, NQCM3Z, NQCM4, NQCM4B, NQCM4Z

Rating : DC 12-1500V, 1-630A

Applicant : Wenzhou Nanque Electric Co., Ltd.
Address : Xirendang Village, Liushi Town, Yueqing City, Wenzhou City, Zhejiang Province, China

Manufacturer : Wenzhou Nanque Electric Co., Ltd.
Address : Xirendang Village, Liushi Town, Yueqing City, Wenzhou City, Zhejiang Province, China

1.2. Test Standards

Test Standards	
EN IEC 61000-6-3: 2021	Emission standard for residential. commercial and light-industrial environments
EN IEC 61000-6-1: 2019	Immunity for residential. commercial and light-industrial environments
EN IEC 61000-3-2: 2019+A1:2021	Electromagnetic compatibility(EMC)-Part 3-2:Limits-Limits for harmonic current emissions(equipment input current $\leq 16A$ per phase)
EN 61000-3-3: 2013+A2:2021	Electromagnetic compatibility(EMC)-Part 3-3:Limits-Limitation of voltage changes,Voltage fluctuations and flicker in public low-voltage supply systems. For equipment with Rated current $\leq 16A$ per phase and not subject to conditional connection

1.3. Test Summary

For the EUT described above.

Table 1: Tests Carried Out Under EN IEC 61000-6-3: 2021

Standard	Test Items	Status
EN IEC 61000-6-3: 2021	Disturbance Voltage at The Mains Terminals (150KHz To 30MHz)	√
	Radiated Disturbances (30MHz To 1000MHz)	√

√ Indicates that the test is applicable

× Indicates that the test is not applicable

Table 2: Tests Carried Out Under EN IEC 61000-6-1: 2019

Standard	Test Items	Status
EN61000-4-2:2009	Electrostatic discharge Immunity	√
EN61000-4-3:2006 +A1:2008+A2:2010	Radiated Susceptibility (80MHz to 1GHz)	√
EN61000-4-4:2004+A1:2010	Electrostatic Fast Transient/Burst Immunity	√
EN61000-4-5:2006	Surge Immunity	√
EN61000-4-6:2009	Conducted Susceptibility (150KHz to 80MHz)	√
EN61000-4-8:2010	Power Frequency Magnetic Field Immunity (12.4.5KW)	√
EN61000-4-11:2004	Voltage Dips Short Interruptions Immunity Tests	√

√ Indicates that the test is applicable

√ Indicates that the test is not applicable

Table 3: Tests Carried Out Under EN IEC 61000-3-2: 2019+A1:2021& EN 61000-3-3:2013

Standard	Test Items	Status
EN IEC 61000-3-2: 2019+A1:2021	Harmonic Current	√
EN 61000-3-3: 2013+A2:2021	Voltage Fluctuations	√

√ Indicates that the test is applicable

√ Indicates that the test is not applicable

1.4. Test Methodology

All measurements contained in this report were conducted with CISPR 16-1: 2002, radio disturbance and immunity measuring apparatus, and CISPR16-2, Method of measurement of disturbances and immunity.

All measurement required was performed at laboratory of Shenzhen Huaxiang Testing Co., Ltd.,

1.5. Test Facility

The test facility is recognized, certified, or accredited by the following organizations:

EMC Laboratory has been registered and fully described in a report filed with the (FCC) Federal Communications Commission. The acceptance letter from the FCC is maintained in our files Registration 222278.

The facility also complies with the radiated and AC line conducted test site criteria set forth in CISPR 16-1, CISPR16-2.

1.6. Measurement Uncertainty

Radiation Uncertainty : $U_r = \pm 3.84\text{dB}$

Conduction Uncertainty : $U_c = \pm 2.72\text{dB}$

2. MEASURING DEVICE AND TEST EQUIPMENT

2.1. For Power Line Conducted Emission

Item	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Test Receiver	Rohde & Schwarz	ESCI EMI TEST RECEIVER	ID:1166.5950K03-101431-Jq	Nov. 20, 2022	1 Year
2.	L.I.S.N.	Rohde & Schwarz	ESH3-Z5	831.5518.52	Nov. 20, 2022	1 Year
3.	Pulse Limiter	SCHWARZ BECK	VTSD 9561-F	9561-G071	Nov. 20, 2022	1 Year

2.2. For Radiated Emission Measurement

Item	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Spectrum Analyzer	Agilent	E4408B	CFG006	Nov. 20, 2022	1 Year
2.	Test Receiver	Rohde & Schwarz	ESPI TEST RECEIVER	ID:1164.6607K03-102109-MH	Nov. 20, 2022	1 Year
3.	Bilog Antenna	Sunol Sciences	Model JB6 Antenna	A090414	Nov. 20, 2022	1 Year
4.	50 Coaxial Switch	Anritsu Corp	MP59B	6100237248	/	/
5.	Horn Ant	Schwarzbeck	Model DRH-118	A091114	Nov. 20, 2022	1 Year

2.3. For Harmonic Current / Flicker Measurement

Item	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Signal Conditioning Unit	SCHAFFNER	CCN1000-1	72314	Nov. 20, 2022	1 Year
2.	Power Supply	SCHAFFNER	NSG1007-3-240	56110	Nov. 20, 2022	1 Year

2.4. For Electrostatic Discharge Immunity Test

Item	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	ESD Tester	PRIMA	ESD61001-630A	144305	Nov. 20, 2022	1 Year

2.5.For Electrical Fast Transient /Burst Immunity Test

Item	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Burst Tester	HTEC	HENQCM1 Z 51	144303	Nov. 20, 2022	1 Year
2.	Coupling Clamp	HAEFELY	IP-4A	147147	/	/

2.6.For Surge Immunity Test

Item	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Surge Tester	HTEC	HCWG	144302	Nov. 20, 2022	1 Year

2.7.For Injected Current Susceptibility Test

Item	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Simulator	SCHAFFNER	NSG2070	1086	Nov. 20, 2022	1 Year
2.	CDN	SCHAFFNER	M016	20812	Nov. 20, 2022	1 Year
3.	CDN	SCHAFFNER	M016	20812	Nov. 20, 2022	1 Year
4.	Attenuator	SCHAFFNER	INA 2070-1	2086	Nov. 20, 2022	1 Year

2.8.For Magnetic Field Immunity Test


Item	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Magnetic Field Tester	HTEC	HPFM T	144301	Nov. 20, 2022	1 Year

2.9.For Voltage Dips and Interruptions Test

Item	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Dips Tester	HTEC	HPFS	144304	Nov. 20, 2022	1 Year

3. POWER LINE CONDUCTED EMISSION MEASUREMENT

3.1. Block Diagram of Test Setup

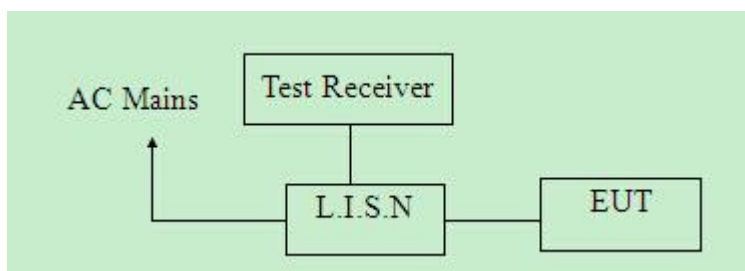

3.2. Measuring Standard

EN IEC 61000-6-3: 2021

Power Line Conducted Emission Limits (Class B)

Frequency (MHz)	Limit (dB μ V)	
	Quasi-peak Level	Average Level
0.15 ~ 0.50	66.0 ~ 56.0 *	56.0 ~ 46.0 *
0.50 ~ 5.00	56.0	46.0
5.00 ~ 30.00	60.0	50.0
NOTE1-The lower limit shall apply at the transition frequencies.		
NOTE2-The limit decreases linearly with the logarithm of the frequency in the range 0.15MHz to 0.50MHz.		

3.3. EUT Configuration on Measurement

The following equipments are installed on Conducted Emission Measurement to meet EN61000-6-3 requirements and operating in a manner which tends to maximize its emission characteristics in a normal application.

EUT : Circuit Breaker
Model Number : NQCM1Z
Serial Number : N/A

3.4. Operating Condition of EUT

3.4.1. Setup the EUT as shown on Section 3.1.

3.4.2. Turn on the power of all equipments.

3.4.3. Let the EUT work in measuring mode (On) and measure it.

3.5. Test Procedure

The EUT is put on the plane 0.8m high above the ground by insulating support and connected to the AC mains through Line Impedance Stability Network (L.I.S.N). This provided a 50ohm coupling impedance for the tested equipments. Both sides of AC line are investigated to find out the maximum conducted emission according to the EN61000-6-3 regulations during conducted emission measurement.

The bandwidth of the field strength meter (R&S Test Receiver ESCI 3) is set at 9KHz in 150KHz~30MHz and 200Hz in 9KHz~150KHz.

The frequency range from 150kHz to 30MHz is investigated


3.6. Measuring Results

PASS

Please reference to the following pages.

Conducted Emission Test Data


EUT : Circuit Breaker Model : NQCM1Z
Operating Condition : Normal Working Test Site: : Shielded Room
Power Supply : DC 12-1500V, 1-630A Phase : L-line
Operator: : Mark Tem : 24℃ Hum:55%
Start of Test: : 2023-08-10

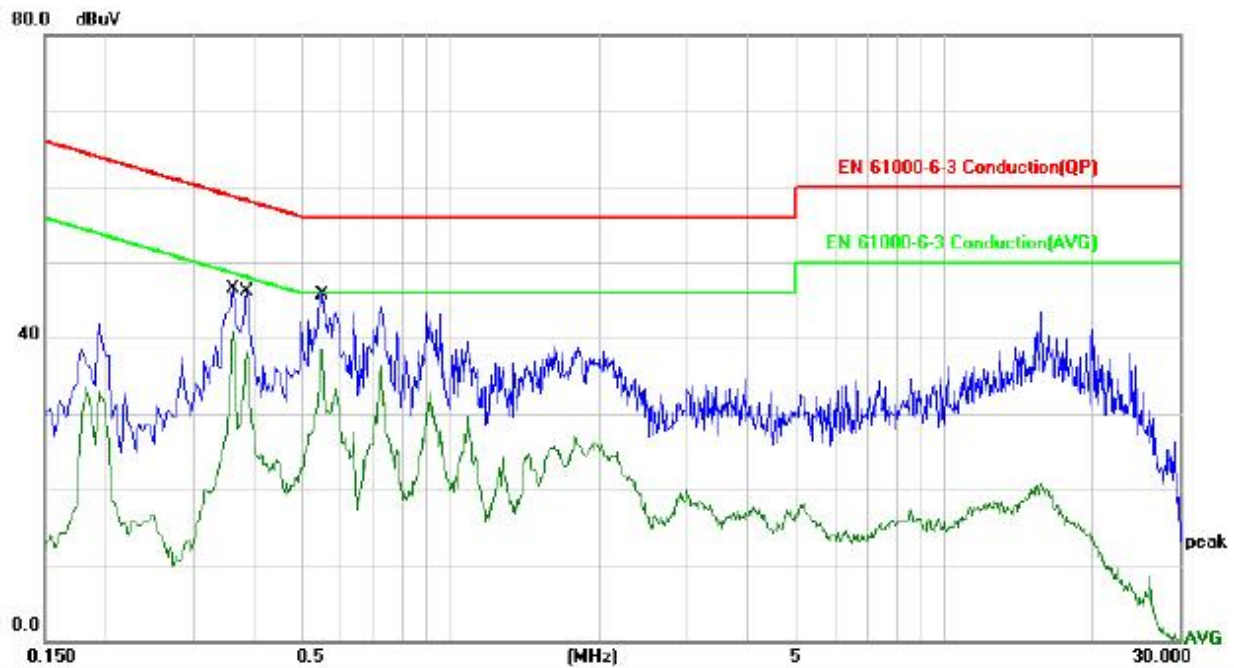

No.	Mk.	Freq.	Reading	Correct	Measure-	Limit	Over		
		MHz	Level	Factor	ment			Detector	Comment
			dBuV	dB	dBuV	dBuV	dB		
1		0.3629	43.37	0.00	43.37	58.66	-15.29	QP	
2		0.3629	39.03	0.00	39.03	48.66	-9.63	AVG	
3		0.3819	34.96	0.00	34.96	58.24	-23.28	QP	
4		0.3819	27.56	0.00	27.56	48.24	-20.68	AVG	
5		0.5512	43.25	0.00	43.25	56.00	-12.75	QP	
6	*	0.5512	36.49	0.00	36.49	46.00	-9.51	AVG	

Conducted Emission Test Data

EUT : Circuit Breaker Model : NQCM1Z
Operating Condition : Normal Working Test Site: : Shielded Room
Power Supply : DC 12-1500V, 1-630A Phase : N-line
Operator: : Mark Tem : 24℃ Hum:55%
Start of Test: : 2023-08-10

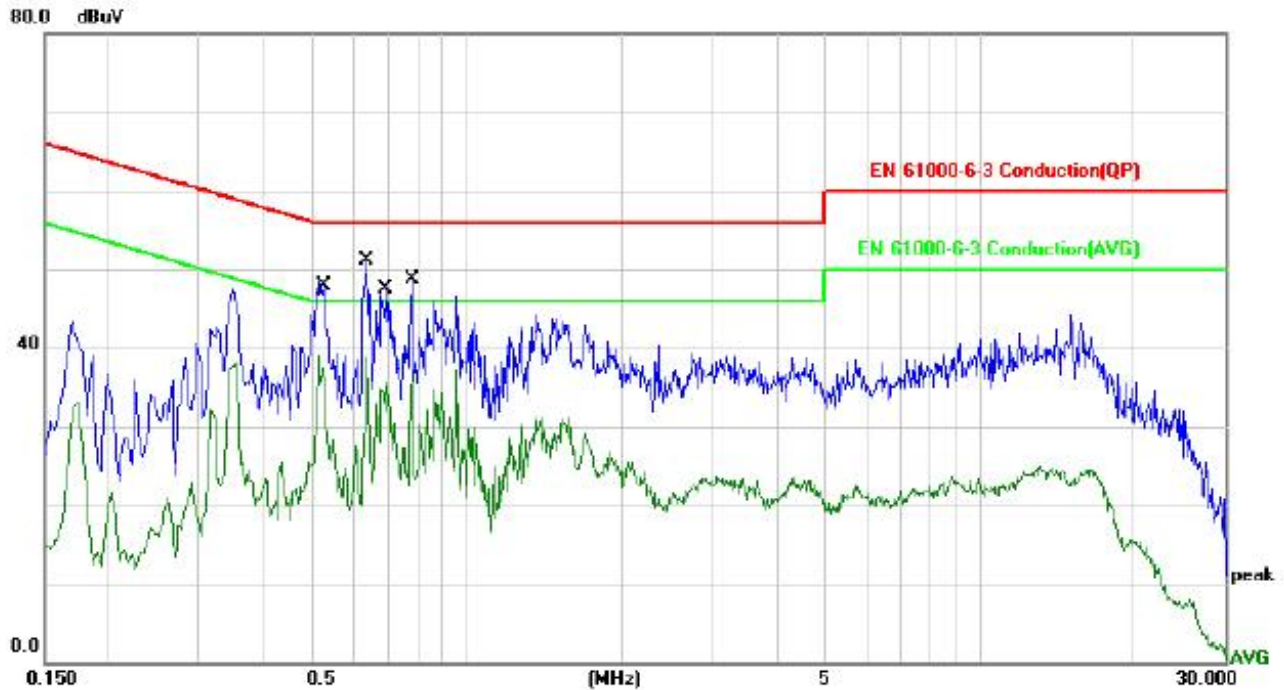


No.	Mk.	Freq.	Reading Level	Correct Factor	Measurement	Limit	Over		
		MHz	dBuV	dB	dBuV	dBuV	dB	Detector	Comment
1		0.5270	43.29	0.00	43.29	56.00	-12.71	QP	
2		0.5270	32.08	0.00	32.08	46.00	-13.92	AVG	
3	*	0.6386	48.19	0.00	48.19	56.00	-7.81	QP	
4		0.6386	37.00	0.00	37.00	46.00	-9.00	AVG	
5		0.6941	38.76	0.00	38.76	56.00	-17.24	QP	
6		0.6941	30.32	0.00	30.32	46.00	-15.68	AVG	
7		0.7811	46.96	0.00	46.96	56.00	-9.04	QP	
8		0.7811	37.50	0.00	37.50	46.00	-8.50	AVG	

4. RADIATED EMISSION MEASUREMENT

4.1. Block Diagram of Test

4.1.1. Block diagram of test setup (In chamber)

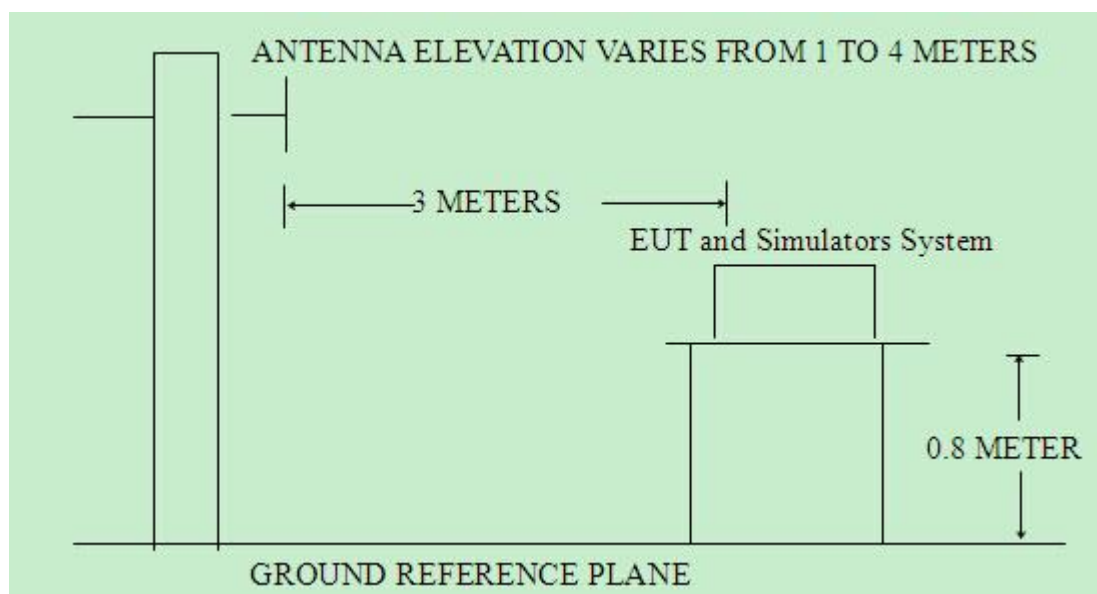

4.2. Measuring Standard

EN IEC 61000-6-3: 2021

4.3. Radiated Emission Limits

All emanations from a class B device or system, including any network of conductors and apparatus connected thereto, shall not exceed the level of field strengths specified below:

FREQUENCY (MHz)	DISTANCE (Meters)	FIELD STRENGTHS LIMIT (dB μ V/m)
30 ~ 230	3	40
230 ~ 1000	3	47

Note: (1) The smaller limit shall apply at the combination point between two frequency bands.

(2) Distance refers to the distance in meters between the measuring instrument antenna and the closed point of any part of the EUT.

4.4. EUT Configuration on Test

The EN61000-6-3 regulations test method must be used to find the maximum emission during radiated emission measurement.

4.5. Operating Condition of EUT

4.5.1. Turn on the power.

4.5.2. After that, let the EUT work in test mode (Normal) and measure it.

4.6. Test Procedure

The EUT is placed on a turn table which is 0.8 meter high above the ground. The turn table can rotate 360 degrees to determine the position of the maximum emission level. The EUT is set 3 meters away from the receiving antenna which is mounted on an antenna tower. The antenna can be moved up and down from 1 to 4 meters to find out the maximum emission level. Bilog antenna (calibrated by Dipole Antenna) is used as a receiving antenna. Both horizontal and vertical polarization of the antenna are set on test.

The bandwidth of the Receiver (ESCI 3) is set at 120kHz.

The frequency range from 30MHz to 1000MHz is investigated.


4.7. Measuring Results

PASS

Please reference to the following pages

Radiated Emission Test Data

EUT	: Circuit Breaker	Model	: NQCM1Z
Operating Condition	: Normal Working	Test Site:	: Shielded Room
Power Supply	: DC 12-1500V, 1-630A	Polarization	: Horizontal
Operator:	: Mark	Tem	: 24℃ Hum:55%
Start of Test:	: 2023-08-10		

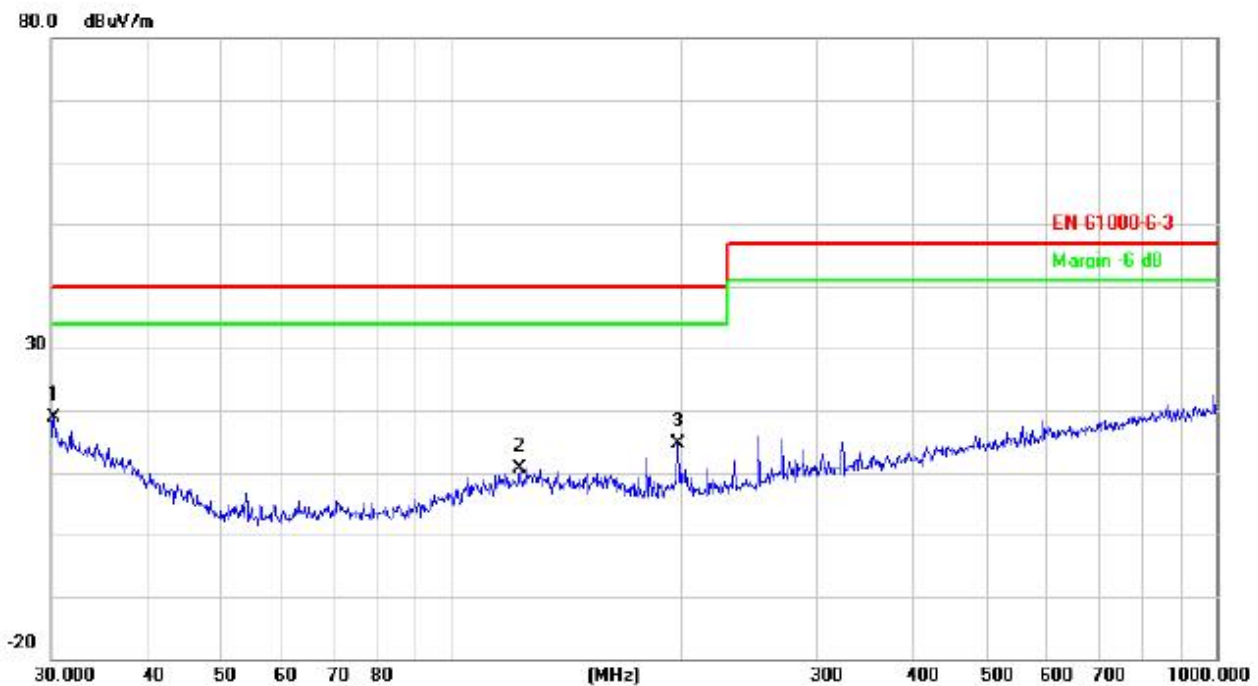

No.	Mk.	Freq.	Reading Level	Correct Factor	Measurement	Limit	Over	Antenna Height	Table Degree	
		MHz	dBuV	dB/m	dBuV/m	dBuV/m	dB	cm	degree	Comment
1	*	30.2111	25.09	-6.27	18.82	40.00	-21.18	peak		
2		122.8340	24.96	-14.34	10.62	40.00	-29.38	peak		
3		197.8928	29.73	-15.20	14.53	40.00	-25.47	peak		

Radiated Emission Test Data


EUT : Circuit Breaker Model : NQCM1Z
Operating Condition : Normal Working Test Site: : Shielded Room
Power Supply : DC 12-1500V, 1-630A Polarization: : Vertical
Operator: : Mark Tem : 24℃ Hum:55%
Start of Test: : 2023-08-10



No.	Mk.	Freq.	Reading Level	Correct Factor	Measurement	Limit	Over	Antenna Height	Table Degree	
		MHz	dBuV	dB/m	dBuV/m	dBuV/m	dB	cm	degree	Comment
1	*	30.2111	23.80	-7.66	16.14	40.00	-23.86			peak
2		138.8735	26.45	-14.65	11.80	40.00	-28.20			peak
3		201.3930	26.31	-15.28	11.03	40.00	-28.97			peak

5. HARMONIC CURRENT EMISSION MEASUREMENT

5.1. Block Diagram of Test Setup

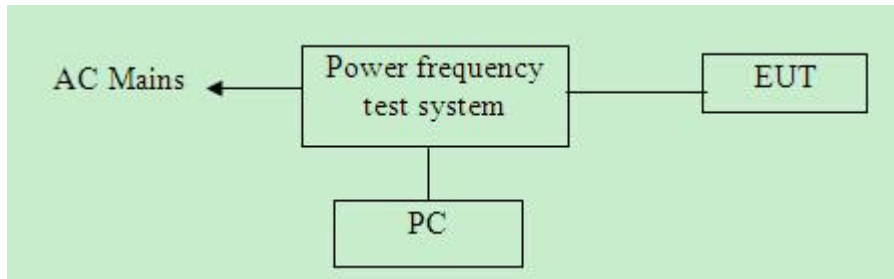

5.2. Measuring Standard

EN IEC 61000-3-2: 2019+A1:2021

5.3. Operation Condition of EUT


Same as Section 3.4, except the test setup replaced as Section 5.1.

5.4. Measuring Results

N/A

6. VOLTAGE FLUCTUATION AND FLICKER MEASUREMENT

6.1. Block Diagram of Test Setup

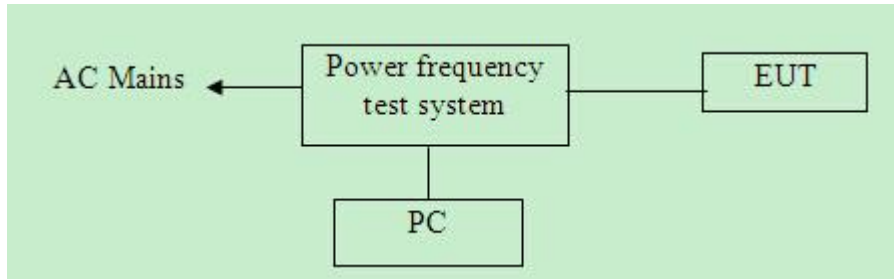

6.2. Measuring Standard

EN 61000-3-3: 2013+A2:2021

6.3. Operation Condition of EUT

6.3.1. Setup the EUT and simulators as shown in Section 6.1.

6.3.2. Turn on the power of all equipments.

6.3.3. Let the EUT work in test modes (Normal) and test it.

6.4. Measuring Results

PASS

Please reference to the following page

EN 61000-3-3 TEST REPORT 2023-08-10 15:23

Unit: Circuit Breaker M/N: NQCM1Z
Test mode: Normal Working

Manufacturer: Wenzhou Nanque Electric Co., Ltd.

Operator: Mark

=====

TEST SETUP

Test Freq.: 50.00 Hz. Test Voltage: 230.0 vac
Waveform : SINE
Test Time: 120.0 min. Tshort: 10.0 min.
Prog. Zo Enabled: YES Prog. Zo: 0.000

Voltage Change less than once per Hour: NO
Impedance selected: IEC-725 STD. REF.

Synthetic R+L Enabled: NO
Resistance: 0.380 Ohms Inductance: 460.000 uH

TEST DATA

Result: PASS

	EUT Data	Limit	Result	Test Enabled
Pst max	0.170	1.00	PASS	true
Plt max	0.152	0.65	PASS	true
dc %	0.00	3.00	PASS	true
dmax %	1.21	4.00	PASS	true
d(t) sec.	0.00	0.20	PASS	true


Power Source Data

Source Pst max	0.231	0.400	PASS	true
% THD	0.03	3.00	PASS	true


7. ELECTROSTATIC DISCHARGE IMMUNITY TEST

7.1. Block Diagram of Test Setup

7.1.1. Block Diagram of the EUT and the simulators

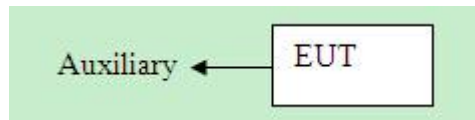

7.1.2. Block diagram of ESD test setup

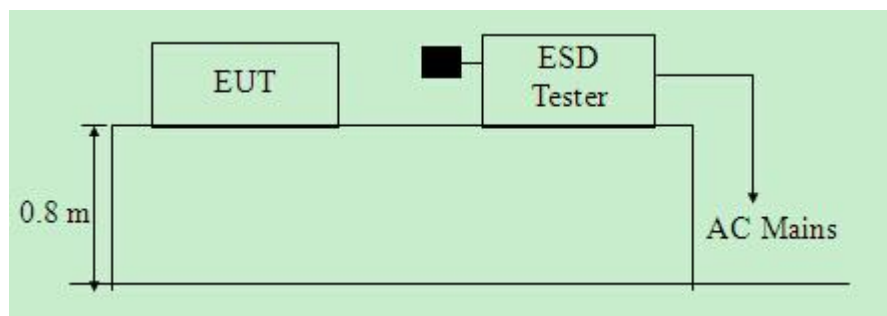

7.2. Test Standard

EN IEC 61000-6-1: 2019(EN61000-4-2: 2009)

Severity Level: 3 / Air Discharge: $\pm 8\text{KV}$ Level: 2 / Contact Discharge: $\pm 4\text{KV}$

7.3. Severity Levels and Performance Criterion

7.3.1. Severity level

Level	Test Voltage Contact Discharge (KV)	Test Voltage Air Discharge (KV)
1	± 2	± 2
2	± 4	± 4
3	± 6	± 8
4	± 8	± 15
X	Special	Special

7.3.2. Performance criterion: **B**

7.4. EUT Configuration

The configuration of EUT is listed in Section 3.3.

7.5. Operating Condition of EUT

Same as conducted emission measurement, which is listed in Section 3.4. Except the test set up replaced by Section 7.1.

7.6. Test Procedure

7.6.1. Air Discharge:

This test is done on a non-conductive surface. The round discharge tip of the discharge electrode shall be approached as fast as possible to touch the EUT. After each discharge, the discharge electrode shall be removed from the EUT. The generator is then re-triggered for a new single discharge and repeated 10 times for each pre-selected test point. This procedure shall be repeated until all the air discharge completed.

7.6.2. Contact Discharge:

All the procedure shall be same as Section 7.6.1. except that the tip of the discharge electrode shall touch the EUT before the discharge switch is operated.

7.6.3. Indirect discharge for horizontal coupling plane

At least 10 single discharges (in the most sensitive polarity) shall be applied at the front edge of each HCP opposite the center point of each unit (if applicable) of the EUT and 0.1m from the front of the EUT. The long axis of the discharge electrode shall be in the plane of the HCP and perpendicular to its front edge during the discharge.

7.6.4. Indirect discharge for vertical coupling plane

At least 10 single discharge (in the most sensitive polarity) shall be applied to the center of one vertical edge of the coupling plane. The coupling plane, of dimensions 0.5m X 0.5m, is placed parallel to, and positioned at a distance of 0.1m from the EUT. Discharges shall be applied to the coupling plane, with this plane in sufficient different positions that the four faces of the EUT are completely illuminated.

7.7. Test Results

PASS

Please refer to the following page

Electrostatic Discharge Test Result


Applicant	: Wenzhou Nanque Electric Co., Ltd.	Test Date	: 2023-08-10
EUT	: Circuit Breaker	Temperature	: 22℃
M/N	: NQCM1Z	Humidity	: 50%
Power Supply	: DC 12-1500V, 1-630A	Test Mode	: Full load
Air discharge	: $\pm 2.0\text{KV}$, $\pm 4.0\text{KV}$, $\pm 6.0\text{KV}$, $\pm 8.0\text{KV}$	Criterion	: B
Contact discharge	: $\pm 2.0\text{KV}$, $\pm 4.0\text{KV}$	Test Engineer	: Mark

Air Discharge						
Test Points	Test Levels			Results		
	$\pm 2\text{kV}$	$\pm 4\text{kV}$	$\pm 8\text{kV}$	Passed	Fail	Performance Criterion
Front	☒	☒	☒	☒	☐	☐ A ☒ B
Back	☒	☒	☒	☒	☐	☐ A ☒ B
Left	☒	☒	☒	☒	☐	☐ A ☒ B
Right	☒	☒	☒	☒	☐	☐ A ☒ B
Top	☒	☒	☒	☒	☐	☐ A ☒ B
Bottom	☒	☒	☒	☒	☐	☐ A ☒ B
Contact Discharge						
Test Points	Test Levels			Results		
	$\pm 2\text{ kV}$	$\pm 4\text{ kV}$	$\pm 6\text{ kV}$	Passed	Fail	Performance Criterion
Front	☒	☒	☐	☒	☐	☐ A ☒ B
Back	☒	☒	☐	☒	☐	☐ A ☒ B
Left	☒	☒	☐	☒	☐	☐ A ☒ B
Right	☒	☒	☐	☒	☐	☐ A ☒ B
Top	☒	☒	☐	☒	☐	☐ A ☒ B
Bottom	☒	☒	☐	☒	☐	☐ A ☒ B
Discharge To Horizontal Coupling Plane						
Side of EUT	Test Levels			Results		
	$\pm 2\text{ kV}$	$\pm 4\text{ kV}$	$\pm 6\text{ kV}$	Passed	Fail	Performance Criterion
Front	☒	☒	☐	☒	☐	☐ A ☒ B
Back	☒	☒	☐	☒	☐	☐ A ☒ B
Left	☒	☒	☐	☒	☐	☐ A ☒ B
Right	☒	☒	☐	☒	☐	☐ A ☒ B
Discharge To Vertical Coupling Plane						
Side of EUT	Test Levels			Results		
	$\pm 2\text{ kV}$	$\pm 4\text{ kV}$	$\pm 6\text{ kV}$	Passed	Fail	Performance Criterion
Front	☒	☒	☐	☒	☐	☐ A ☒ B
Back	☒	☒	☐	☒	☐	☐ A ☒ B
Left	☒	☒	☐	☒	☐	☐ A ☒ B
Right	☒	☒	☐	☒	☐	☐ A ☒ B


8. RF FIELD STRENGTH SUSCEPTIBILITY TEST

8.1. Block Diagram of Test

8.1.1. Block diagram of connection between the EUT and Load

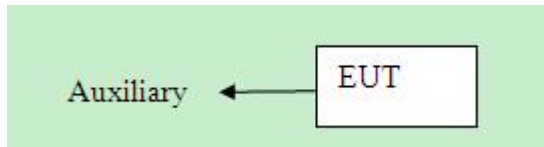

8.1.2. Block diagram of RS test setup

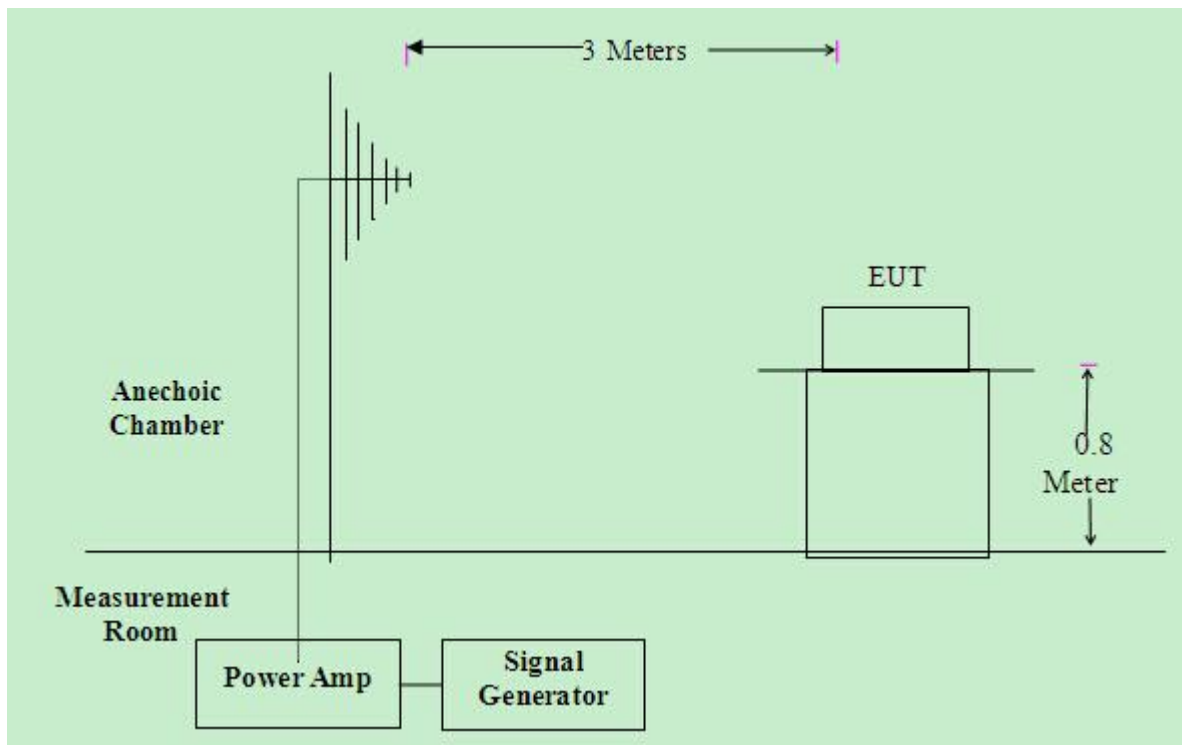

8.2. Test Standard

EN IEC 61000-6-1: 2019(EN61000-4-3:2006 +A1:2008+A2:2010 (Severity Level: 2, 3V / m)

8.3. Severity Levels and Performance Criterion

8.1.3 .Severity Levels

Level	Field Strength V/m
1	1
2	3
3	10
X	Special

8.1.4. Performance Criterion : A

8.4. EUT Configuration on Test

The configuration of the EUT is same as Section 3.3.

8.5. Operating Condition of EUT

Same as radiated emission measurement which is listed in Section 3.4, except the test setup replaced as Section 8.1.

8.6. Test Procedure

The EUT are placed on a table which is 0.8 meter high above the ground. The

EUT is set 3 meters away from the transmitting antenna which is mounted on an antenna tower. Both horizontal and vertical polarization of the antenna are set on test. Each of the four sides of the EUT must be faced this transmitting antenna and measured individually.

In order to judge the EUT performance, a CCD camera is used to monitor its screen.

All the scanning conditions are as following:

Condition of Test	Remark
1. Fielded Strength	3V/m (Severity Level 2)
2. Radiated Signal	Modulated
3. Scanning Frequency	80-1000MHz
4. Sweep time of radiated	0.0015 Decade/s
5. Dwell Time	1 Sec.

8.7. Test Results

PASS

Please refer to the following page.


RF Field Strength Susceptibility Test Results

Applicant	: Wenzhou Nanque Electric Co., Ltd.	Test Date	: 2023-08-10
EUT	: Circuit Breaker	Temperature	: 22℃
M/N	: NQCM1Z	Humidity	: 50 %
Field Strength	: 3 V/m	Criterion	: A
Power Supply	: DC 12-1500V, 1-630A	Test Mode	: Normal
Test Engineer	: Mark	Frequency Range	: 80 MHz to 1000 MHz
Modulation:		☐ None	☐ Pulse
			☒ AM 1KHz 80%
Frequency Rang 1: 80~ 1000MHz		Frequency Rang 2: 1400~ 2000MHz	
Steps	1	/	%
	Horizontal	Vertical	Horizontal
Front	PASS	PASS	PASS
Right	PASS	PASS	PASS
Rear	PASS	PASS	PASS
Left	PASS	PASS	PASS
Test Equipment : 1. Signal Generator : 2031 (MARCONI) 2. Power Amplifier : 500A100 & 100W/1000M1 (A&R) 3. Power Antenna : 3108 (EMCO) & AT1080 (A&R) 4. Field Monitor : FM2000 (A&R)			
Note:			


9. ELECTRICAL FAST TRANSIENT/BURST IMMUNITY TEST

9.1. Block Diagram of Test Setup

9.1.1. Block Diagram of the EUT

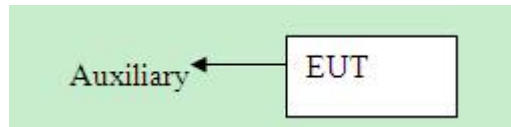

9.1.2. EUT Test Setup

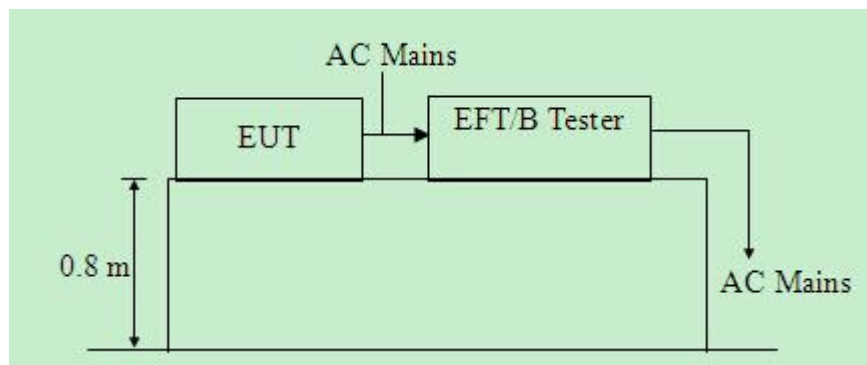

9.2. Test Standard

EN IEC 61000-6-1: 2019(EN61000-4-4:2004+A1:2010, Severity Level, Level 2: 1KV)

9.3. Severity Levels and Performance Criterion

9.3.1. Severity level

Open Circuit Output Test Voltage $\pm 10\%$		
Level	On Power Supply Lines	On I/O (Input/Output) Signal data and control lines
1	0.5 KV	0.25 KV
2	1 KV	0.5 KV
3	2 KV	1 KV
4	4 KV	2 KV
X	Special	Special

9.3.2. Performance criterion : **B**

9.4. EUT Configuration

The configuration of EUT is listed in Section 3.3.

9.5. Operating Condition of EUT

9.5.1. Setup the EUT as shown in Section 9.1.

9.5.2. Turn on the power of all equipments.

9.5.3. Let the EUT work in test mode (Normal) and measure it.

9.6. Test Procedure

The EUT is put on the table which is 0.8 meter high above the ground. This reference ground plane shall project beyond the EUT by at least 0.1m on all sides and the minimum distance between EUT and all other conductive structure, except the ground plane beneath the EUT, shall be more than 0.5m.

9.6.1. For input and output AC power ports:

The EUT is connected to the power mains by using a coupling device which couples the ENQCM1Z interference signal to AC power lines. Both polarities of the test voltage should be applied during compliance test and the duration of the test is 2 mins.

9.6.2. For signal lines and control lines ports:

No I/O ports. It's unnecessary to test.

9.6.3. For DC output line ports:

It's unnecessary to test.

9.7. Test Result

PASS

Please reference to the following page


Electrical Fast Transient/Burst Test Results

[illegible]


10.SURGE IMMUNITY TEST

10.1.Block Diagram of Test Setup

10.1.1.Block Diagram of the EUT

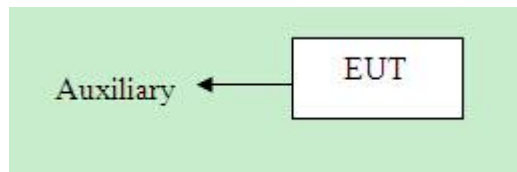

10.1.2.Surge Test Setup

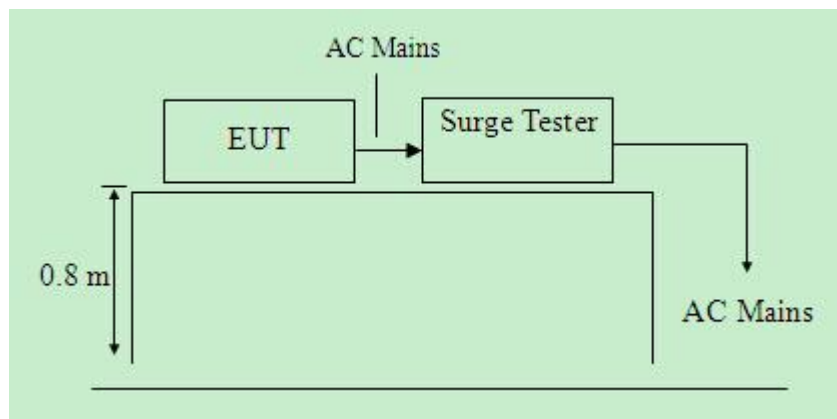

10.2.Test Standard

EN IEC 61000-6-1: 2019(EN61000-4-5: 2006)

Severity Level: Line to Line: Level 2, 1.0KV

10.3.Severity Levels and Performance Criterion

10.3.1.Severity level

Severity Level	Open-Circuit Test Voltage KV
1	0.5
2	1.0
3	2.0
4	4.0
*	Special

10.3.2.Performance criterion : B

10.4.EUT Configuration

The configuration of EUT is listed in Section 3.3.

10.5.Operating Condition of EUT

10.5.1.Setup the EUT as shown in Section 10.1.

10.5.2.Turn on the power of all equipments.

10.5.3.Let the EUT work in test mode (Normal) and measure it.

10.6.Test Procedure

10.6.1.Set up the EUT and test generator as shown on Section 10.1.2.

10.6.2.For line to line coupling mode, provide a 1.0 KV 1.2/50us voltage surge
(at open-circuit condition) and 8/20us current surge to EUT selected points.

10.6.3.At least 5 positive and 5 negative (polarity) tests with a maximum 1/min repetition rate
are conducted during test.

10.6.4.Different phase angles are done individually.

10.6.5.Record the EUT operating situation during compliance test and decide the EUT
immunity criterion for above each test.

10.7.Test Result

PASS

Please reference to the following page

Surge Immunity Test Result

Applicant : <u>Wenzhou Nanque Electric Co., Ltd.</u>				Test Date : <u>2023-08-10</u>	
EUT : <u>Circuit Breaker</u>				Temperature : <u>22℃</u>	
M/N : <u>NQCM1Z</u>				Humidity : <u>50%</u>	
Power Supply : <u>DC 12-1500V, 1-630A</u>				Test Mode : <u>Normal</u>	
Test Engineer : <u>Mark</u>				Criterion : <u>B</u>	


Location	Polarity	Phase Angle	Number of Pulse	Pulse Voltage (KV)	Result
L-N	+	0°	5	1.0	PASS
	+	90°	5	1.0	PASS
	+	180°	5	1.0	PASS
	+	270°	5	1.0	PASS
	-	0°	5	1.0	PASS
	-	90°	5	1.0	PASS
	-	180°	5	1.0	PASS
	-	270°	5	1.0	PASS
L-PE	+	0°	5	2.0	PASS
	+	90°	5	2.0	PASS
	+	180°	5	2.0	PASS
	+	270°	5	2.0	PASS
	-	0°	5	2.0	PASS
	-	90°	5	2.0	PASS
	-	180°	5	2.0	PASS
	-	270°	5	2.0	PASS
N-PE	+	0°	5	2.0	PASS
	+	90°	5	2.0	PASS
	+	180°	5	2.0	PASS
	+	270°	5	2.0	PASS
	-	0°	5	2.0	PASS
	-	90°	5	2.0	PASS
	-	180°	5	2.0	PASS
	-	270°	5	2.0	PASS

Remark:	Test Equipment : Surge Tester P surge4.1
---------	---


11.INJECTED CURRENTS SUSCEPTIBILITY TEST

11.1.Block Diagram of Test Setup

11.1.1.Block Diagram of the EUT

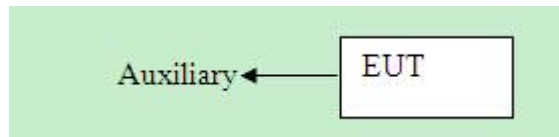

11.1.2.Block Diagram of Test Setup

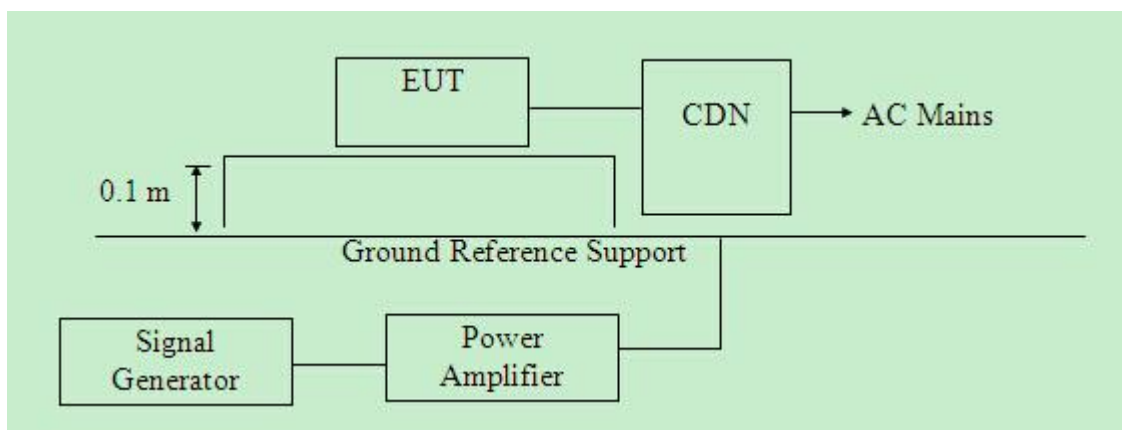

11.2.Test Standard

EN IEC 61000-6-1: 2019 (EN61000-4-6: 2009, Severity Level: Level 2, 3V (rms), (0.15MHz ~ 80MHz)

11.3.Severity Levels and Performance Criterion

11.3.1.Severity level

Level	Field Strength V
1	1
2	3
3	10
X	Special

11.3.2.Performance criterion: A

11.4.EUT Configuration

The configuration of EUT is listed in Section 3.3.

11.5. Operating Condition of EUT

11.5.1. Setup the EUT as shown in Section 11.1.

11.5.2. Turn on the power of all equipments.

11.5.3. Let the EUT work in test mode (Normal) and measure it.

11.6. Test Procedure

11.6.1. Set up the EUT, CDN and test generators as shown on Section 11.1.2.

11.6.2. Let the EUT work in test mode and measure it.

11.6.3. The EUT are placed on an insulating support 0.1m high above a ground reference plane.

CDN (coupling and decoupling device) is placed on the ground plane about 0.3m from EUT. Cables between CDN and EUT are as short as possible, and their height above the ground reference plane shall be between 30 and 50 mm (where possible).

11.6.4. The disturbance signal described below is injected to EUT through CDN.

11.6.5. The EUT operates within its operational mode(s) under intended climatic conditions after power on.

11.6.6. The frequency range is swept from 150KHz to 80MHz using 3V signal level, and with the disturbance signal 80% amplitude modulated with a 1KHz sine wave.

11.6.7. The rate of sweep shall not exceed 1.5×10^{-3} decades/s. Where the frequency is swept incrementally, the step size shall not exceed 1% of the start and thereafter 1% of the preceding frequency value.

11.6.8. Recording the EUT operating situation during compliance test and decide the EUT immunity criterion.

11.7. Test Results

PASS

Please reference to the following page


Injected Currents Susceptibility Test Results

Applicant : <u>Wenzhou Nanque Electric Co., Ltd.</u>			Test Date: <u>2023-08-10</u>	
EUT : <u>Circuit Breaker</u>			Temperature : <u>22℃</u>	
M/N : <u>NQCM1Z</u>			Humidity : <u>58%</u>	
Power Supply : <u>DC 12-1500V, 1-630A</u>				
Test Engineer : <u>Mark</u>				
Test Mode : <u>Normal</u>				
Frequency Range (MHz)	Injected Position	Strength (Unmodulated)	Criterion	Result
0.15 ~ 80	AC Input	3V	A	PASS
Test Mode : _____				
Frequency Range (MHz)	Injected Position	Strength (Unmodulated)	Criterion	Result
Remark : 1. Modulation Signal:1KHz 80% AM Measurement Equipment : Simulator: CWS 500 (SWITZERLAND EMTEST) CDN : ☒ CDN-M2 (SWITZERLAND EMTEST) ☒ CDN-M3 (SWITZERLAND EMTEST)		Note:		


12.MAGNETIC FIELD SUSCEPTIBILITY TEST

12.1.Block Diagram of Test

12.1.1.Block diagram of test setup

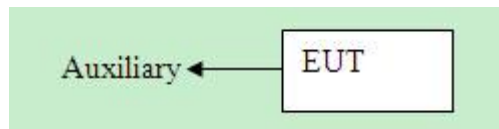

12.1.2.Magnetic field test setup

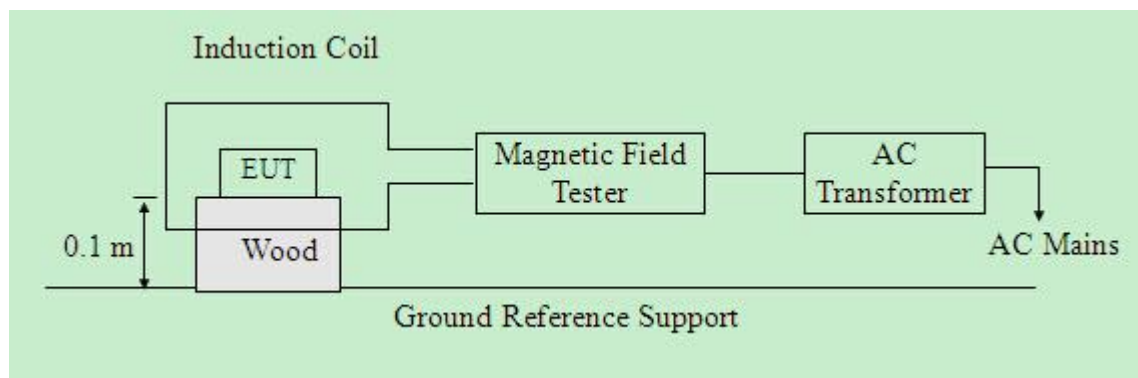

12.2.Test Standard

EN IEC 61000-6-1: 2019 (EN61000-4-8: 2010, Severity Level: Level 1, 1A / m)

12.3.Severity Levels and Performance Criterion

12.3.1.Severity Levels

Level	Field Strength A/m
1	1
2	3
3	10

4	30
5	100
X	Special

12.3.2.Performance Criterion : A

12.4.EUT Configuration on Test

The configuration of the EUT is same as Section 3.3.

12.5.Test Procedure

The EUT is placed in the middle of a induction coil (1*1m), under which is a 1*1*0.1m (high) table, this small table is also placed on a larger table,0.8 m above the ground. Both horizontal and vertical polarization of the induction coil are set on test, so that each side of the EUT is affected by the magnetic field. Also can reach the same aim by change the position of the EUT.

12.6.Test Results

PASS

Please reference to the following page

Standard	☐ IEC 61000-4-8 ☒ EN 61000-4-8		Result: ☒ Pass / ☐ Fail	
Applicant : Wenzhou Nanque Electric Co., Ltd. EUT : Circuit Breaker M/N: NQCM1Z Input Voltage : DC 12-1500V, 1-630A Date of Test : 2023-08-10 Test Engineer: Mark Ambient Condition : Temp : 22°C Humid: 58% Criterion: A				
Operation Mode : Normal				
Test Level (A/M)	TeN/A Duration	Coil Orientation	Criterion	Result
3	5 mins	X	A	PASS
3	5 mins	Y	A	PASS
3	5 mins	Z	A	PASS
Operation Mode :				
Test Level (A/M)	TeN/A Duration	Coil Orientation	Criterion	Result
Test Equipment	Magnetic Field Test: HEAFELY MAG 100.1			
Note:				


13.VOLTAGE DIPS AND INTERRUPTIONS TEST

13.1.Block Diagram of Test Setup

13.1.1.Block Diagram of the EUT



13.1.2.Dips Test Setup

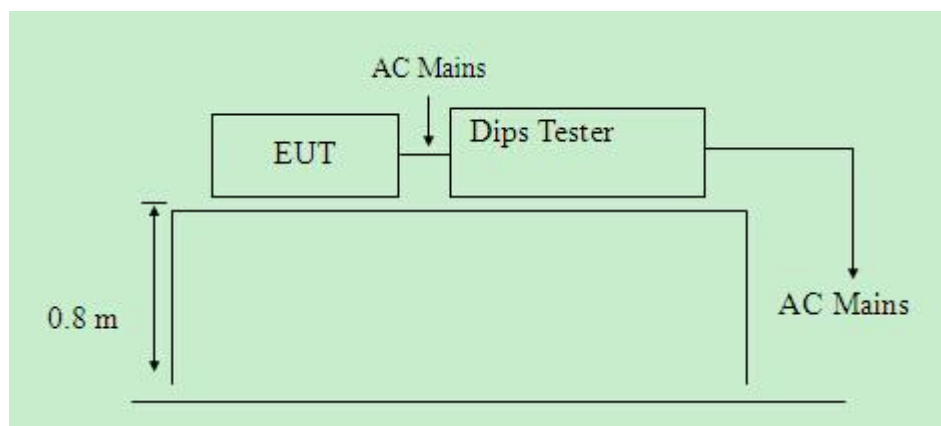

13.2.Test Standard

EN IEC 61000-6-1: 2019(EN61000-4-11: 2004)

13.3.Severity Levels and Performance Criterion

13.3.1.Severity level

Test Level %UT	Voltage dip and short interruptions %UT	Duration (in period)
0	100	0.5
40	60	1
70	30	5
		10
		25
		50
		*

13.3.2.Performance criterion : **B&C**

13.4.EUT Configuration

The configuration of EUT is listed in Section 3.3.

13.5.Operating Condition of EUT

13.5.1 Setup the EUT as shown in Section 13.1.

13.5.2 Turn on the power of all equipments.

13.5.3 Let the EUT work in test mode (Normal) and measure it.

13.6.Test Procedure

13.6.1.Set up the EUT and test generator as shown on Section 13.1.2.

13.6.2.The interruptions is introduced at selected phase angles with specified duration.

13.6.3.Record any degradation of performance.

13.7.Test Result

PASS

Please reference to the following page

Voltage Dips And Interruptions Test Results

Applicant : <u>Wenzhou Nanque Electric Co., Ltd.</u>			Test Date : <u>2023-08-10</u>	
EUT : <u>Circuit Breaker</u>			Temperature : <u>22°C</u>	
M/N : <u>NQCM1Z</u>			Humidity : <u>50%</u>	
Power Supply : <u>DC 12-1500V, 1-630A</u>			Test Engineer : <u>Mark</u>	
Test Mode: <u>Normal</u>				
Test Level % U _T	Voltage Dips & Short Interruptions % U _T	Duration (in periods)	Criterion ☐ A ☒ B ☒ C ☐ D	Result P=PASS F=Fail
0	100	250P	C	P
70	30	25P	C	P
0	100	1P	B	P
0	100	0.5P	B	P
Test Mode :				
Test Level % U _T	Voltage Dips & Short Interruptions % U _T	Duration (in periods)	Criterion ☐ A ☐ B ☐ C ☐ D	Result P=PASS F=FAIL
Note:				

APPENDIX I
(Photos of EUT)

FIGURE
GENERAL APPEARANCE OF EUT



Fig. 1

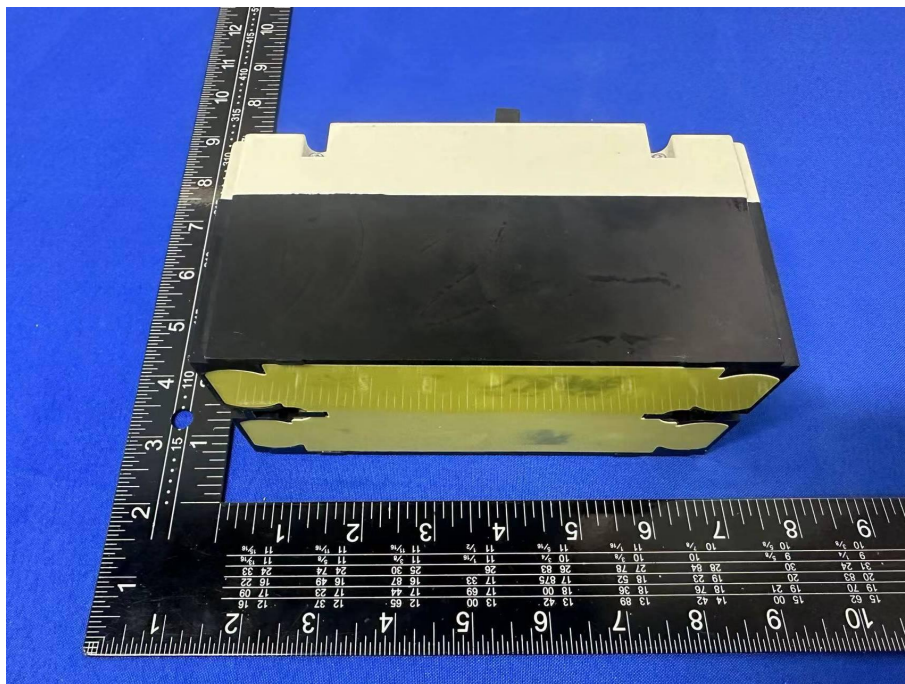


Fig. 2

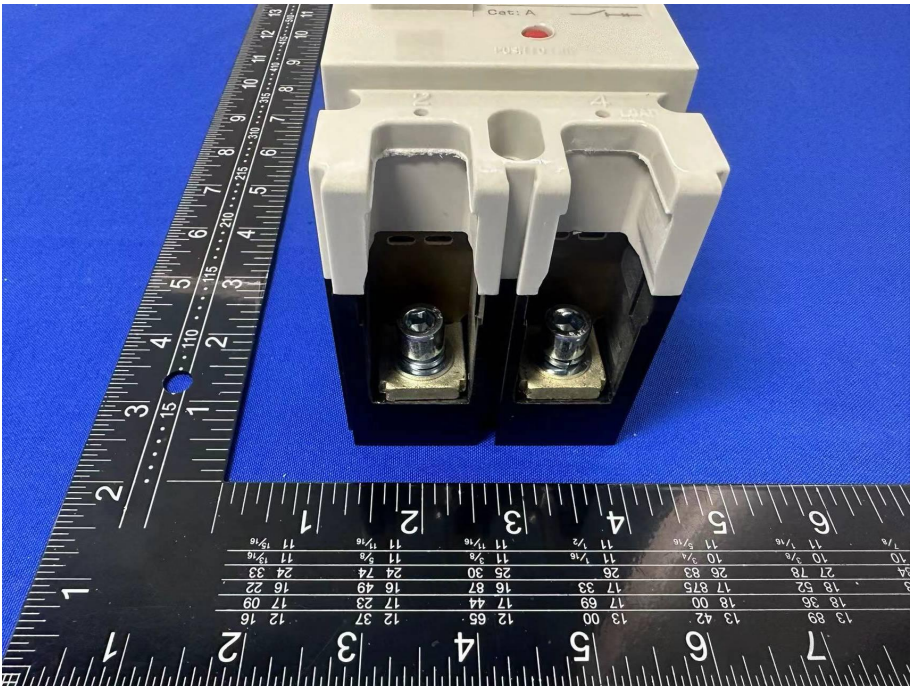


Fig. 3



Fig. 4

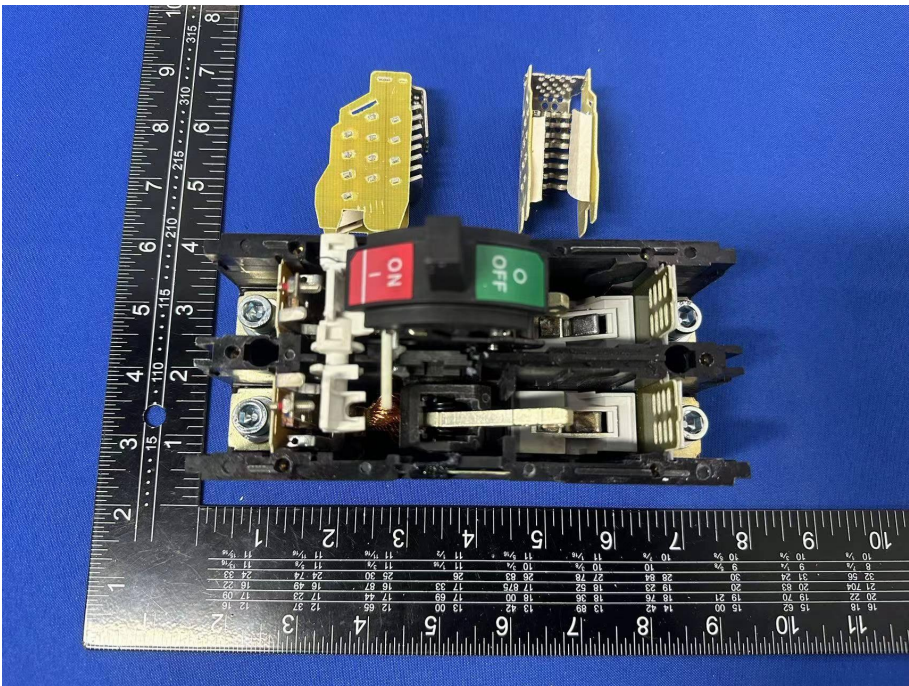


Fig. 5

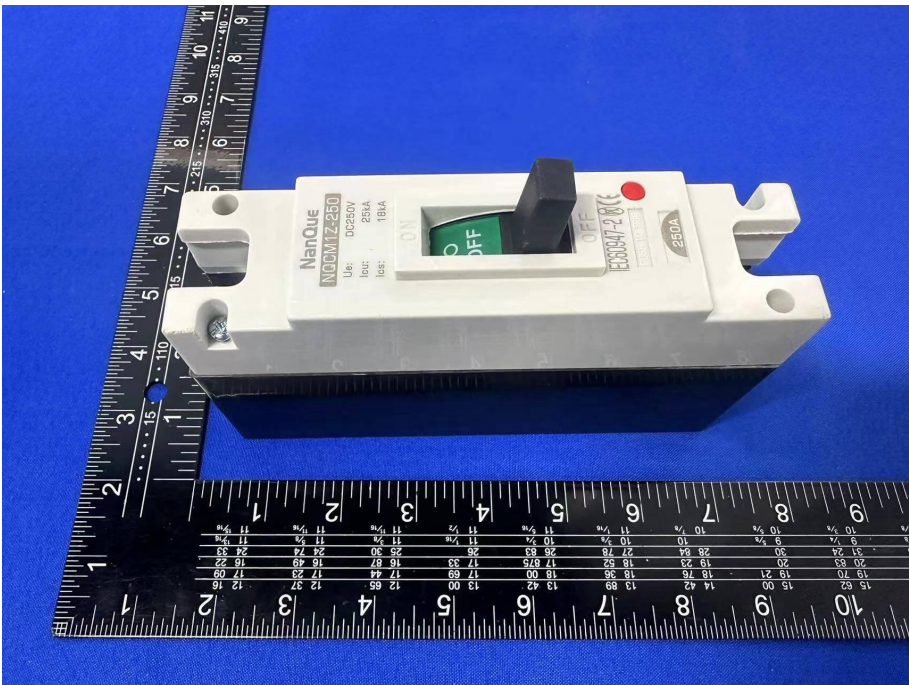


Fig. 6

*****THE END OF REPORT*****